

ASC-4 Battery

Data sheet



1. ASC-4 Battery

1.1 About	3
1.1.1 Key features	3
1.1.2 Key concepts	5
1.2 Single battery controller	6
1.3 Power management	8
1.3.1 Grid-tied	8
1.3.2 Off-grid	10
1.3.3 Safe power management	12
1.3.4 Options	12
1.3.5 Applications	12
1.3.6 Plant modes	13
1.3.7 Power management functions	13
1.3.8 Easy configuration of single-line diagrams	14
1.4 Open PMS	15
1.4.1 Grid-tied open PMS	15
1.4.2 Off-grid open PMS	16
1.4.3 Open PMS	16
1.5 Communication protocols	18
1.5.1 Compatibility and compliance	18
1.5.2 List of supported protocols	18
1.6 Application emulation	19

2. Hardware and software

2.1 Overview and options	20
---------------------------------	-----------

3. Compatible products

3.1 Touch display unit: TDU	22
3.2 Power management	22
3.3 Open PMS	22
3.4 Power meters	22
3.5 Power measurements from gensets	23
3.6 Remote monitoring service: Insight	23
3.7 Additional operator panel, AOP-2	23
3.8 Other equipment	23

4. Technical information

4.1 Technical specifications	24
4.2 Unit dimensions in mm (inches)	28

5. Ordering information

5.1 Order specifications	29
5.2 Disclaimer	29
5.3 Software version	29

1. ASC-4 Battery

1.1 About

The ASC-4 Battery controller can be used as a single controller to add a storage system to an existing site, or with other DEIF controllers in a power/energy management system. The ASC-4 Battery controller controls and protects an energy storage system (ESS) with communication to a BCU, PCS, PDS and BMS. The ASC-4 Battery controller can instruct all gensets to stop, and supply the load from battery alone or in combination with sustainable power production.



In an energy management system, the controller is designed for seamless integration of electrical storage with other power sources. You can prioritise the energy sources for supplying the load, and recharging the battery. The ASC-4 Battery controller includes a configurable charge scheme (charge/discharge levels).

The controller has built-in AC measurements. There are two sets of voltage measurements (three phases, and (optional) the neutral phase), and one set of current measurements (three phases).

Operators can easily control the system from the display unit. Alternatively, use the communication options to connect to an HMI/SCADA system.

1.1.1 Key features

Applications

	Single battery controller	Power management systems
Applications	Brownfield	Greenfield
Storage integration in hybrid systems (including microgrids)	●	●
Applications with sustainable power plants	-	Up to 16 power plants
Communicates with BCU, PCS, PDS and BMS over Modbus <ul style="list-style-type: none">Monitor and troubleshoot the Modbus communication from the ASC-4 display unit	●	●
Configurable charge scheme	●	●
Charging/discharging based on SOC or automatic timers	●	●
Controls functions, energy source or power source	●	●
Grid-forming (V/f mode) Grid-following (P/Q mode) Droop mode (P/f and Q/V) (like a virtual synchronous generator)	●	●
Ideal for self-consumption applications	●	●
Control of ESS breaker (optional)	●	●
AC- and DC-coupled storage systems	●	●

	Single battery controller	Power management systems
Frequency response	●	●
Power DC-DC system (PDS): DC-coupled solar or DC-charger, current limitation, spinning reserve for the DC-busbar	●	●

Using ASC-4 Battery with gensets

	Single battery controller	Power management systems
Applications	Brownfield	Greenfield
Connect to gensets for storage-diesel	Up to 16 gensets (requires power meters)	Up to 32 gensets (with AGC-4 Mk II/AGC 150)
Power meter interfacing	●	Not required
Optimal genset load constraint	●	●
Minimum genset load constraint	●	●
Load-dependent genset start/stop	By digital output	By PMS
SOC-dependent genset start/stop	By digital output	By PMS

Easy to use

	Single battery controller	Power management systems
Simple graphical configuration with the free PC tool	●	●
Highly customisable with user-friendly M-Logic tool	●	●
Effective commissioning with DEIF emulation (use and verify the functions of the real system for design, production and testing)	●	●

Optimal operation

	Single battery controller	Power management systems
Applications	Brownfield	Greenfield
Define and change the priorities of connected power sources	-	●
Uptime guaranteed through spinning reserve	-	●
Maximised sustainable power production	*	●

NOTE * The single battery controller aims for maximum sustainable power production. However, power management systems can better maximise sustainable power production.

Scalable and flexible

You can easily add controllers to an application, rearrange applications, and move controllers from single controller applications to PMS (or the other way around).

Hardware

DEIF-developed platform, manufactured in Denmark. Flexible configuration.

1.1.2 Key concepts

Grid-forming or grid-following

These modes are controlled by the ASC-4 Battery controller using the PCS and BCU.

- **Grid-forming**

Grid-forming is also called island, or V/f mode. For grid-forming (V/f mode) the ASC-4 Battery controller can act as the only energy source. The battery can provide the grid-forming power in island operation, and work together with non-grid-forming sources, like solar and wind.

If the system includes gensets, these are stopped if the load level, battery capacity, and state of charge conditions are fulfilled. When the battery is discharged or the load increases beyond the battery capacity, the gensets are reconnected. The controller can also suppress genset starts from Solar controller spinning reserve requests.

- **Grid-following**

Grid-following is also called parallel, or P/Q mode. For grid-following (P/Q mode), the ASC-4 Battery controller is always connected to another grid-forming source, like a mains or genset. The battery can be used as power buffer, providing spinning reserve and peak shaving.

- **Droop mode**

If the ESS supports this, the ASC-4 Battery controller can run the ESS in droop mode for both Grid-forming and Grid-following. The controller controls the storage charge and discharge using V/f or P/Q set points from the configured droop curve (that is, like a virtual synchronous generator (VSG)).

Energy source or power source

The energy and power source functions determine the source priority. The source functions are not directly related to grid-forming and grid-following.

- **Energy source**

For the energy source function (plant-leading), the ASC-4 Battery controller prioritises battery power over genset power. As a result, the system uses as much battery power as possible before starting any genset.


- **Power source**

For the power source function (plant assist), the ASC-4 Battery controller operates parallel to other sources. Genset power is prioritised over battery power. This mode is used to ensure that spinning reserve requirements are met.


AC- or DC-coupled

The ASC-4 Battery controller can be used for both AC- and DC-coupled ESS applications.


For AC-coupled systems, you can define battery charging and discharging scheme. Using the charge scheme, in DEIF power management, you'll also be able to define the energy sources (gensets, PV or mains) that you allow for charging purposes.

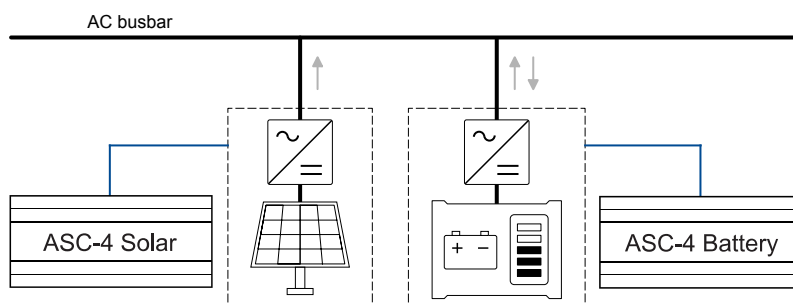

For DC-coupled systems, the battery is charged by its own PV bus. Depending on the PV-Battery system and supplier, the ASC-4 Battery controller can communicate with the PV inverter, and limit the current from the PV to the battery.

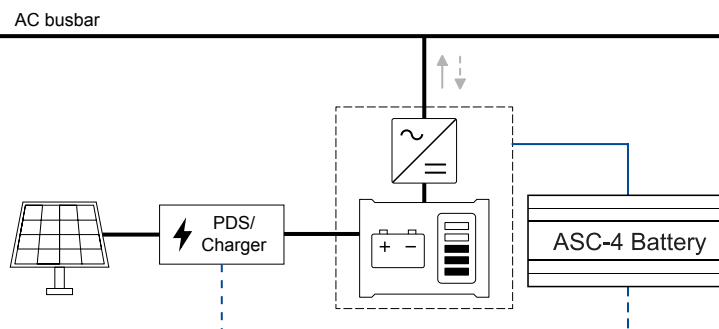


Single battery controller with one mains

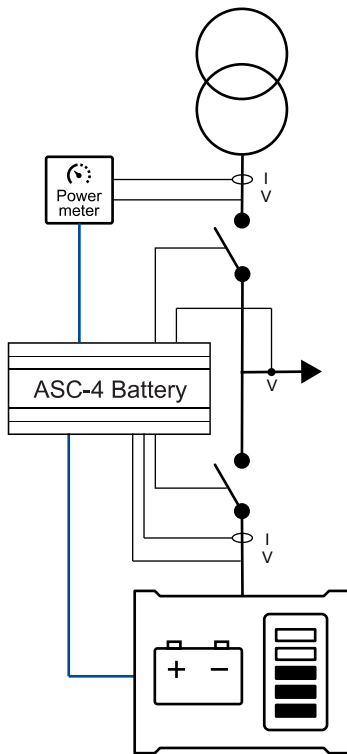

- **Peak shaving:** The storage supplies the peak load demand and runs parallel to mains.
- **Load take-over:** The load is moved from mains to storage, for example, during peak demand periods or periods with a risk of power outages.
- **Mains power export:** The ASC continuously adjusts the ESS so that the power through the mains breaker is at the fixed power set point. Both import and export are possible.

Single battery controller with PV

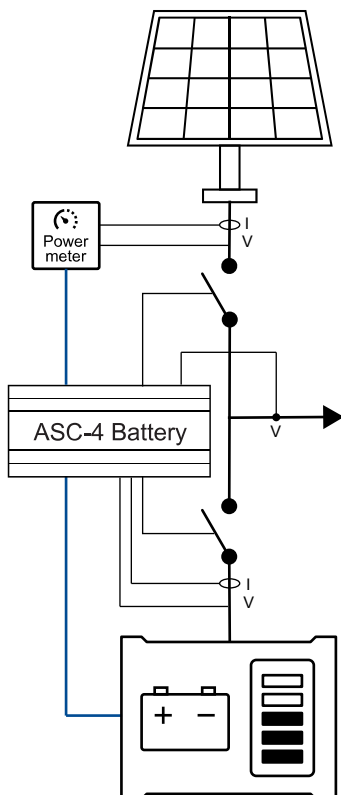

1.3 Power management

The power management system ensures that the controllers work together to control all power sources and breakers. Power management can ensure safety, fuel optimisation, easy implementation of plant logic, and so on.

1.3.1 Grid-tied


The ASC-4 Battery controllers can integrate seamlessly into grid-tied applications. This includes power management applications with other DEIF controllers using CAN bus communication.

The ASC-4 Battery can control an ESS to take peak loads, provide mains power export, provide fixed power. If there is a mains failure, the controller can run in island mode. The ASC-4 Battery can also provide the spinning reserve for a PV plant, thereby improving the green energy penetration to the grid.


These controller configurations can be used in greenfield applications.

To use these configurations at existing sites, all the genset, mains, battery and solar controllers must be replaced with DEIF controllers. Existing BTB controllers can be replaced, or treated as externally controlled BTBs.


Grid-tied battery

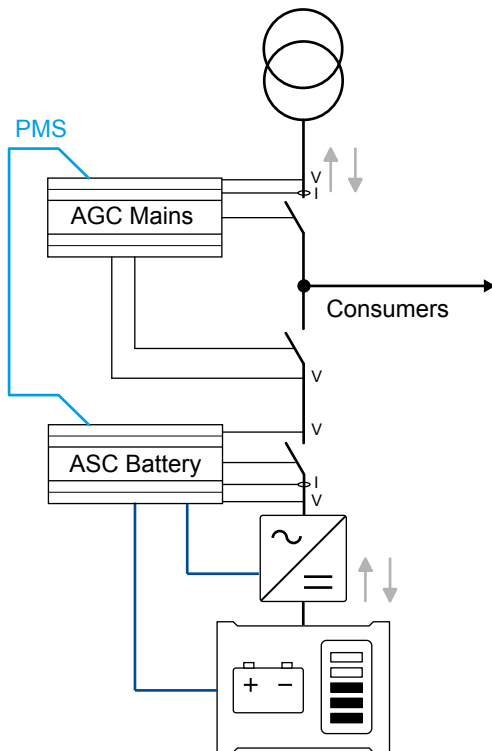


Grid-tied hybrid genset-battery

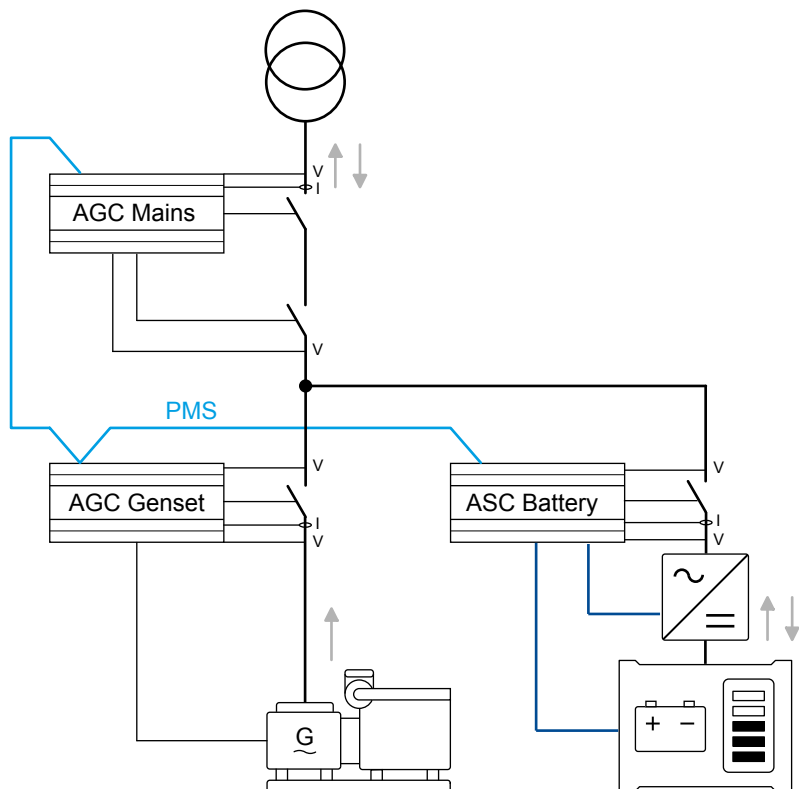


Grid-tied hybrid solar-battery

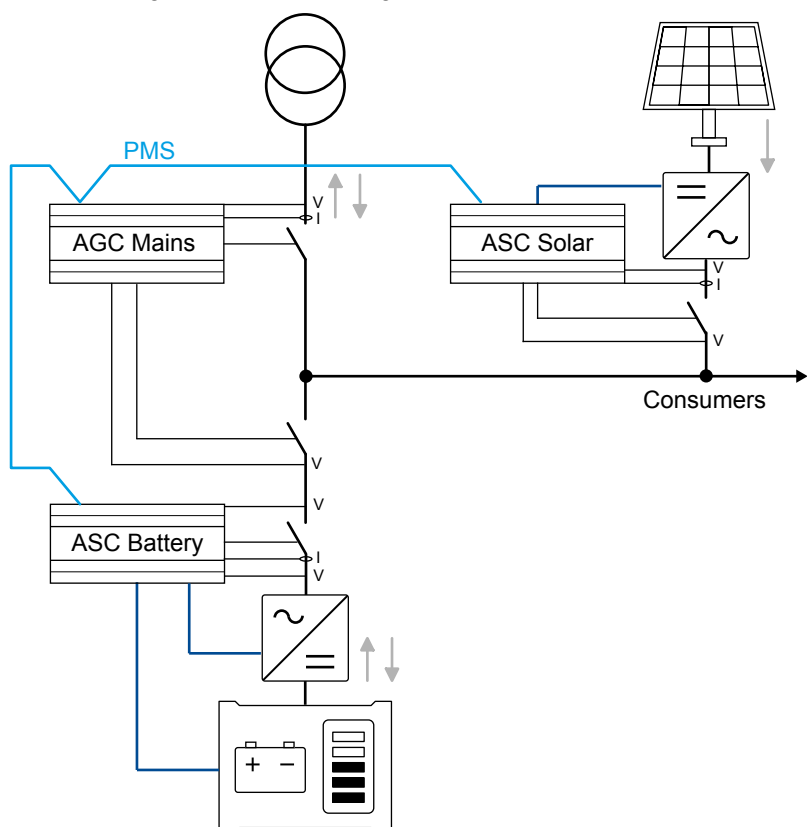

Grid-tied hybrid solar-genset-battery

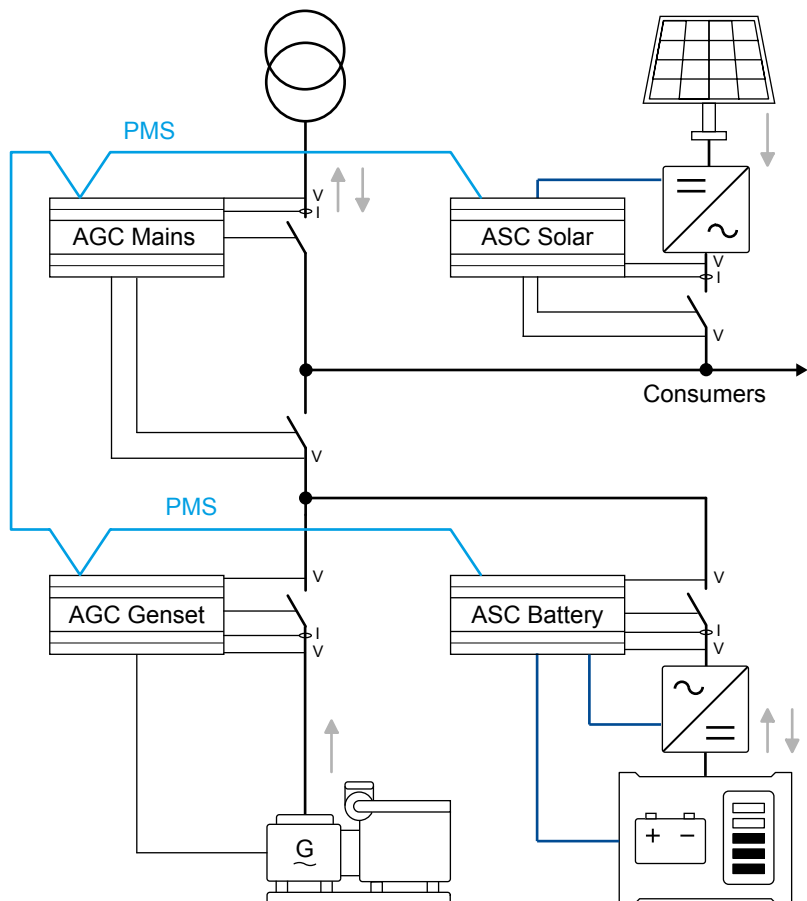

Multi-mains with battery

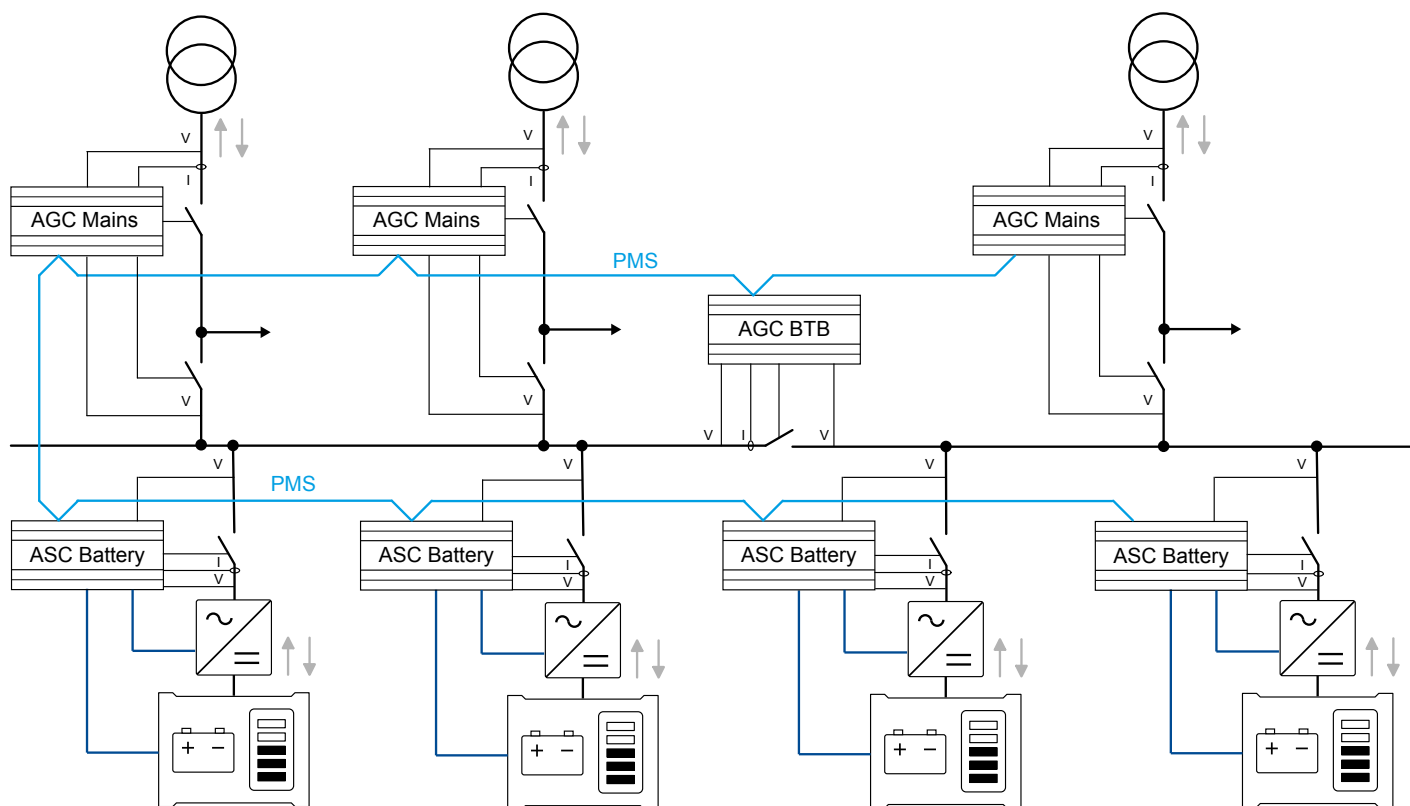


1.3.2 Off-grid

The ASC-4 Battery controllers provide flexibility for off-grid applications.


These controller configurations can be used in greenfield applications.

To use these configurations at existing sites, all the genset, battery and solar controllers must be replaced with DEIF controllers. Existing BTB controllers can be replaced, or treated as externally controlled BTBs.

Off-grid with solar and battery

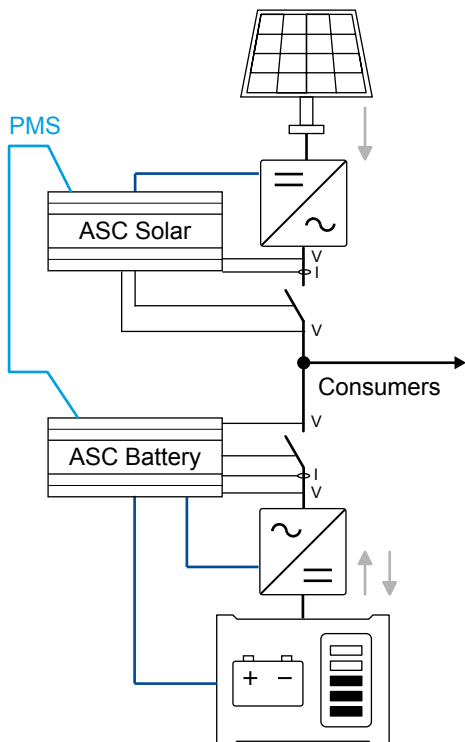


Off-grid with genset(s) and battery

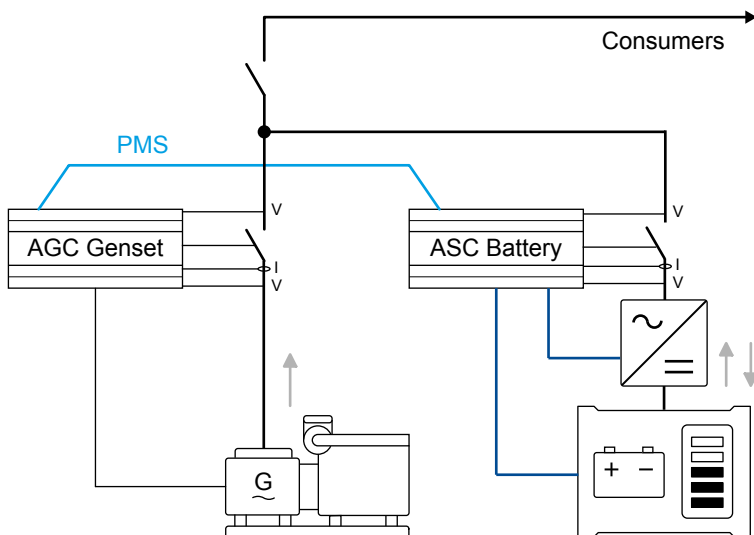

To improve power quality, the ASC-4 Battery can supply peak loads while gensets start. The ASC-4 Battery controller can support the load, so that the genset can run at its optimal load point. If the ESS is designed to supply the busbar load, the ESS can be the only source connected to the busbar.

Off-grid with genset(s), solar and battery

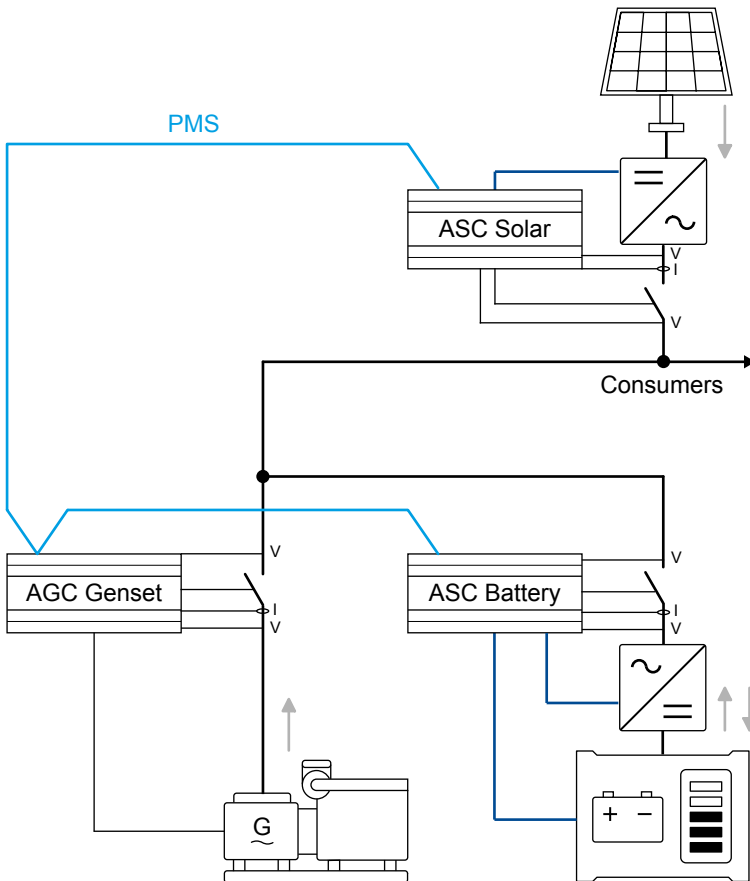

1.3.3 Safe power management

Multi-master system

The power management system is designed as a multi-master system for increased reliability. In a multi-master system all vital data is transmitted between the controllers, giving all controllers knowledge of the present power management status (calculations and position) in the application. This makes the application immune to failing master controllers and makes the controllers suitable for all types of applications, including emergency standby, and critical power applications.

Redundant CAN bus

In critical power and emergency standby applications requiring extra operation reliability, redundant CAN bus communication lines can be used. This ensures reliable CAN bus communication for power management if one of the CAN lines is damaged.

Redundant controller

With the Critical Power option (T1) it is possible to have redundant controllers in the application. The redundant controller is connected on the CAN line as a hot standby unit and is therefore always updated with the system status and ready to become the primary controller.

1.3.4 Options

To use power management, the ASC-4 Battery controller must include option G5. The ASC-4 Battery controller does not support extended power management (option G7).

1.3.5 Applications

With power management, the controllers can handle simple or advanced applications for a variety of power plant projects. Applications include synchronising gensets, critical power, emergency standby, and power production.

For power management (option G5), the following can be controlled:

- 32 gensets and/or mains with breakers (ID 1 to 32)
- 8 bus tie breakers on the generator bus or load bus (ID 33 to 40)
- 16 automatic sustainable controllers ASC-4 (solar and/or battery) (ID 25 to 40, ASC SW 4.10.0 or greater)
- 8 automatic load controllers ALC-4 (ID 25 to 40, ALC SW 4.10.0 or greater)

The complete power management system can easily be monitored from the PC utility SW through a graphical supervision page. Running status, hours in operation, breaker status, condition of mains and busbars and fuel consumption are just some of the values that are presented.

1.3.6 Plant modes

The plant can be divided by one to eight bus tie breakers. This makes it possible to run the plant with different plant modes. For example, for test purposes, or when splitting up the load in primary and secondary loads.

1.3.7 Power management functions


	Genset (G5)	Mains (G5)	BTB (G5)	Group (G7)	Plant (G7)
Multi-master system	●	●	●	●	●
Redundant CAN bus	●	●	●	●	●
Load management	●	●	●	●	●
Load-dependent start/stop	●			●	
<ul style="list-style-type: none"> • Manual priority • Running hours priority • Running hours priority • Fuel optimisation priority 	Absolute/relative Absolute/relative Total/trip/load profiled ●			Absolute Absolute	
Neutral earth relay (Ground relay)	●			●	
Safety stop of genset	●				
N + X (Secured mode)	1-8 extra gensets			1 extra group	
<ul style="list-style-type: none"> • Equal load sharing • Asymmetric load sharing 	● ●			● ●	
Base load running for maintenance (island plants)	●				
Analogue load sharing for backup	●				
Easy connect (for genset application setup)	●				
Short-time parallel	- *	● **			
ATS control		●			●
Plant PF control		●			●
Mains feeder control, feeders paralleled		●			●
Mains feeder control, main-tie-main for critical power		●			●
Section power control			●		

NOTE * For a genset controller, short-time parallel is only possible in a single genset application (that is, without power management). The genset controller must control the GB and MB.

NOTE ** For a mains controller, short-time parallel is only possible if the controller controls the TB and MB.

1.3.8 Easy configuration of single-line diagrams


You can easily configure the application using a PC and the DEIF PC utility software. You can then set up the plant control, by using a few basic plant conditions.

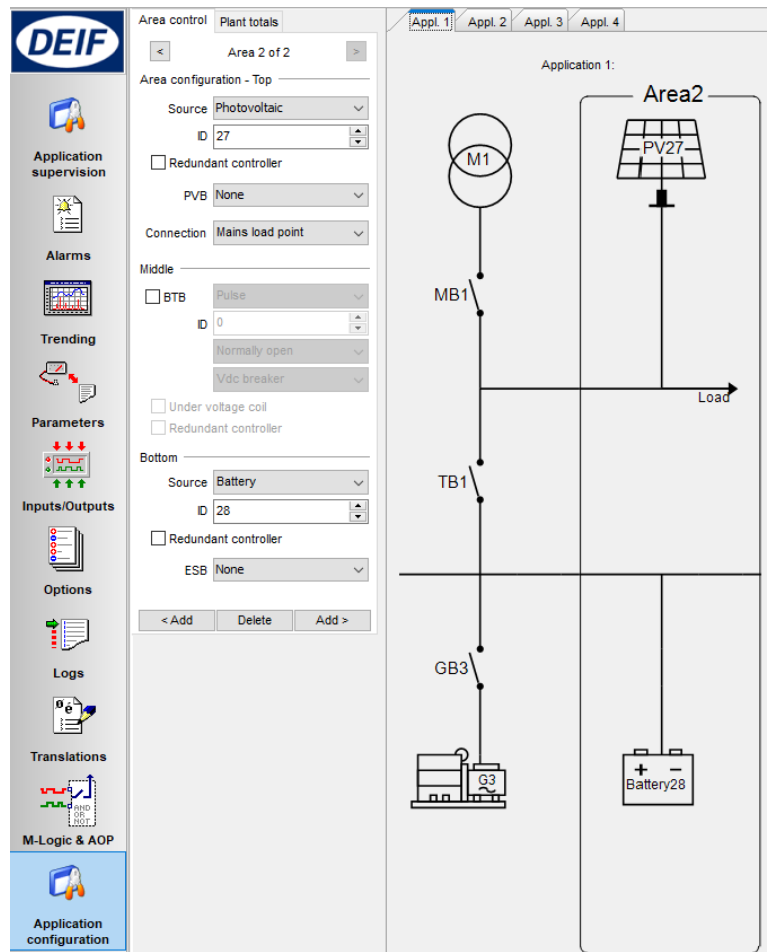


1.4 Open PMS

1.4.1 Grid-tied open PMS


Grid-tied solar, storage and external mains

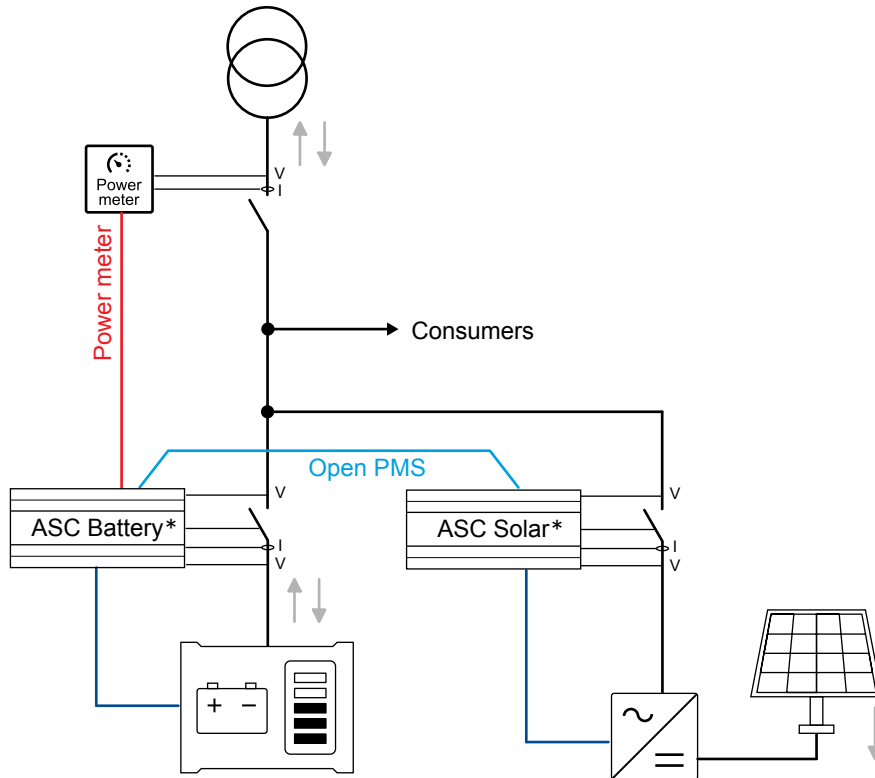

Grid-tied solar, storage, external genset(s) and external mains

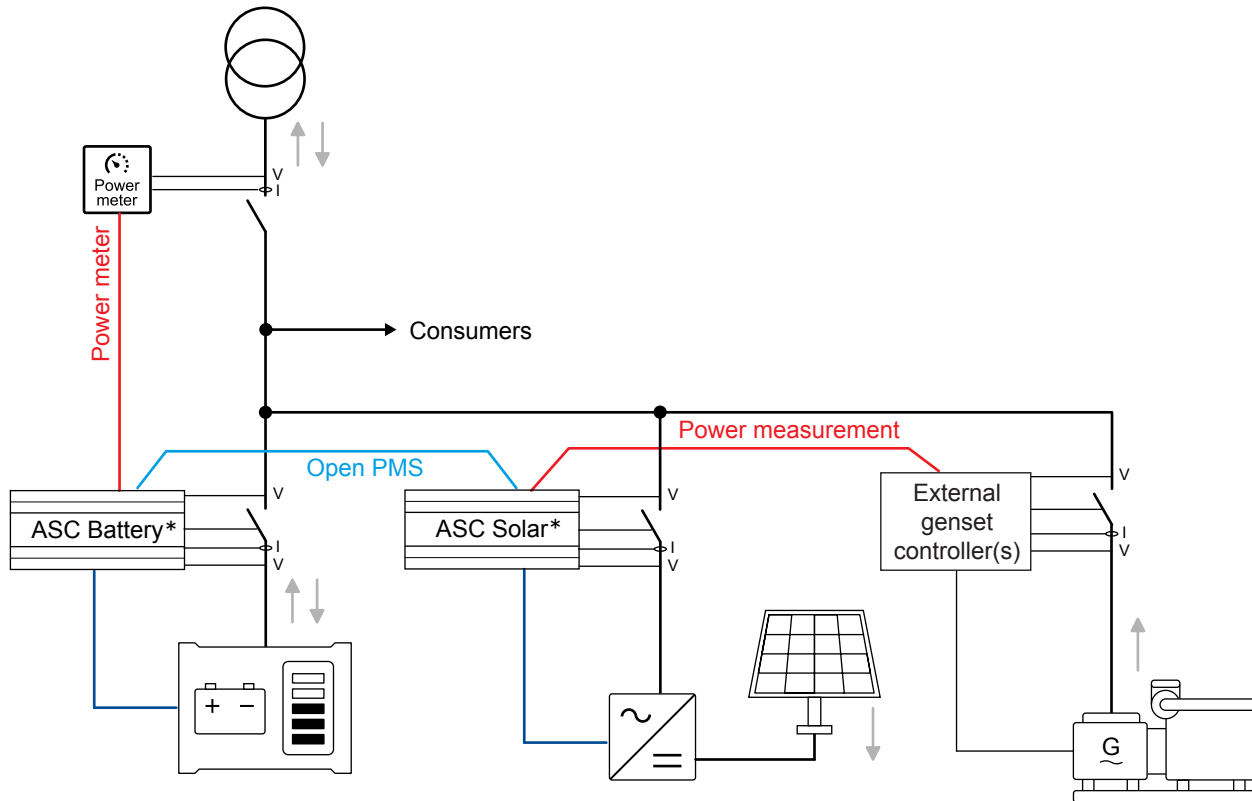


Grid-tied solar, storage, mains and external genset(s)

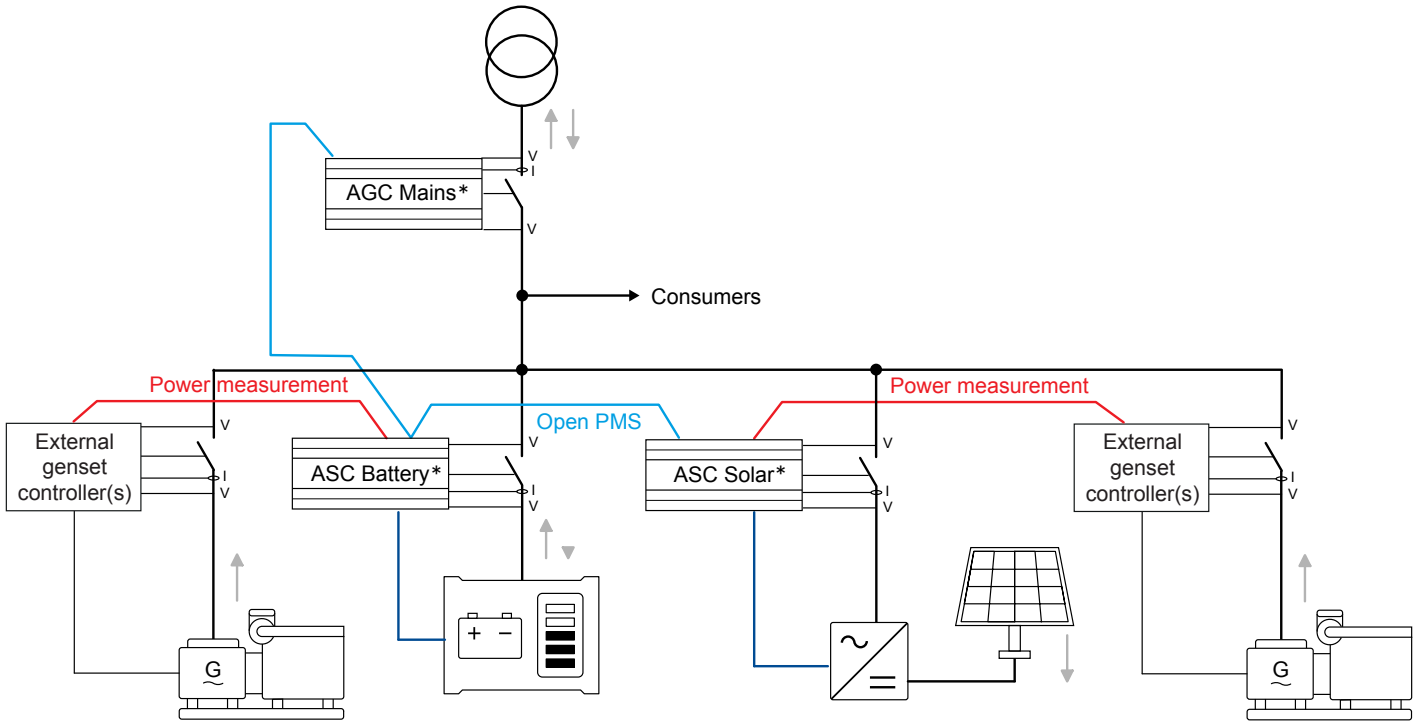

NOTE * You can use multiple controllers in the application. Power measurements can be connected to the closest ASC controller.

1.4.2 Off-grid open PMS

Off-grid solar, storage and external genset(s)

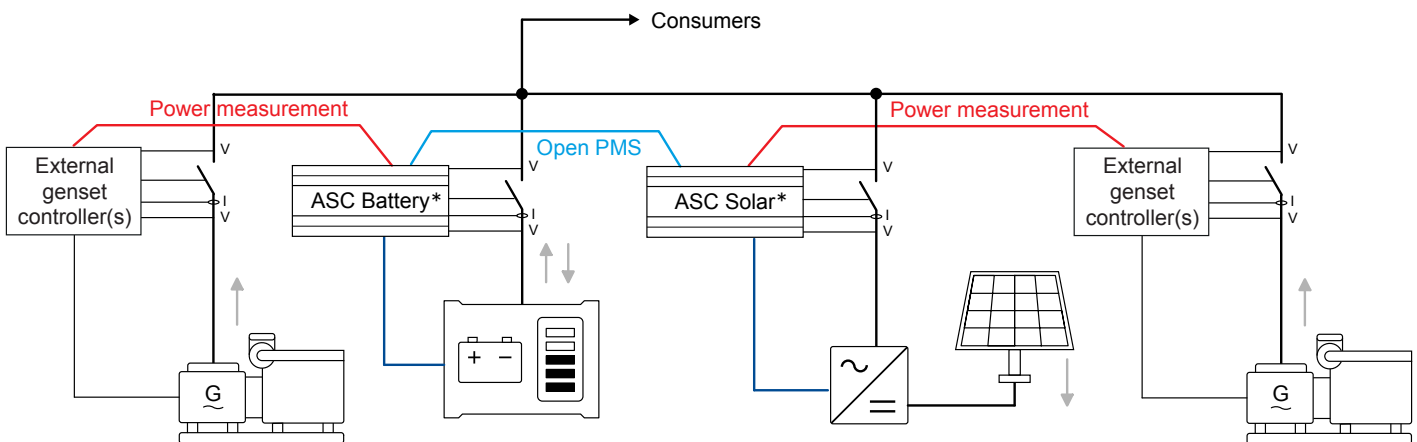

NOTE * You can use multiple controllers in the application. Power measurements can be connected to the closest ASC controller.

NOTE If there is a stop signal to a genset, the connected storage controller can change the storage power reference to deload the genset. Similarly, if there is a stop signal to a genset, the connected solar controller can change the solar power reference to deload the genset.

1.4.3 Open PMS

Open PMS is a power management system that consists of solar and/or storage controllers (ASC 150 and/or ASC-4). Open PMS can also include a mains controller. The ASC controller(s) get power measurements from the externally controlled power source(s). You can therefore use open PMS to add power management to a brownfield application.

Open PMS automatically supplies the power that is necessary for the load efficiently, safely and reliably:

- Automatically maximises PV power
- Automatically closes and opens breakers
- Balances the loads in the system
- Deploys logic

The open PMS operating data can be shown graphically on the controller display. You can also monitor open PMS from a graphical supervision page in the utility software.

Open PMS features

Open PMS features	Extended	Premium
Power management operation limits:		
• External generator controllers per solar/storage controller	4	16
• Mains controllers*	32	32
• External mains connections	1	1
• Solar controllers*	16	16
• Storage (BESS) controllers*	16	16
EasyConnect	●	●
External sources included in the available power:		
• Supply the busbar load	●	●
• Charge batteries	●	●
• Minimum and optimal genset load	●	●

*Restrictions on controllers

ID 1 to 24	ID 25 to 32	ID 33 to 40
AGC Mains (1 to 32)		
	ASC Solar (25 to 40)	
	ASC Storage/Battery (25 to 40)	

Plant modes with a mains controller

With a mains controller, open PMS supports:

- Configurable mains power set point
- Configurable mains operating mode
- Auto-start signal for the application to the mains controller
- Standard AGC mains PMS features, including cos phi set points, and mains breaker control

Standard plant modes	Applications
Island mode	Power plant with synchronising generators.
Automatic Mains Failure	Critical power/emergency standby plants, black start generator.
Fixed power	Power plant with fixed kW set point (including building load).
Peak shaving	Power plant where generator supplies peak load demand paralleled to the mains.
Load take-over	Plant mode where the load is moved from mains to generator. For example, peak demand periods, or periods with a risk of power outages.
Mains power export	Power plant with fixed kW set point (excluding building load).

Plant modes with an external mains

The ASC that is connected to the external mains operates as an *AGC mains lite* and controls the mains mode.

Standard plant modes	Applications
Fixed power	Power plant with fixed kW set point (including building load).
Peak shaving	Power plant where generator supplies peak load demand paralleled to the mains.
Mains power export	Power plant with fixed kW set point (excluding building load).

NOTE For an open external mains breaker, open PMS cannot synchronise so that the mains breaker can close. That is, open PMS runs in island mode and cannot back sync.

1.5 Communication protocols

1.5.1 Compatibility and compliance

DEIF hybrid controllers are compatible with battery systems from a wide range of manufacturers.

Testing

Many battery system makers use the same protocol for a wide range of their products. New battery systems often comply with the older protocol. If a specific battery management system is not listed, but the maker is listed, there is a good chance that the DEIF controller is compatible.

If your battery system is not listed, DEIF can help to confirm compliance using the Modbus protocol documentation.

Implementing new protocols

Since new battery systems are launched every year, DEIF developers continuously implement new protocols. If your system is not listed, please contact DEIF. We can work with you to quickly implement the required protocol.

1.5.2 List of supported protocols

The ASC-4 Battery supports a wide range of power meters, power measurements from genset controllers, and BCU, PCS, PDS, BMS, and ESS protocols.



More information


See the **Application note, DEIF hybrid controller compatibility**.

1.6 Application emulation

Use the emulation tool to verify and test the functionality. The emulation tool makes it possible to test most of the functions, for example, plant modes and logics, breaker handling, mains and generator operation. Emulation only requires a DC supply and CAN bus between the controllers.


Application emulation is useful for training, customising plant requirements, and testing basic functionality.

In a power management system, the entire plant can be controlled using the PC Utility Software tool, if there is a TCP/IP connection to one of the controllers.

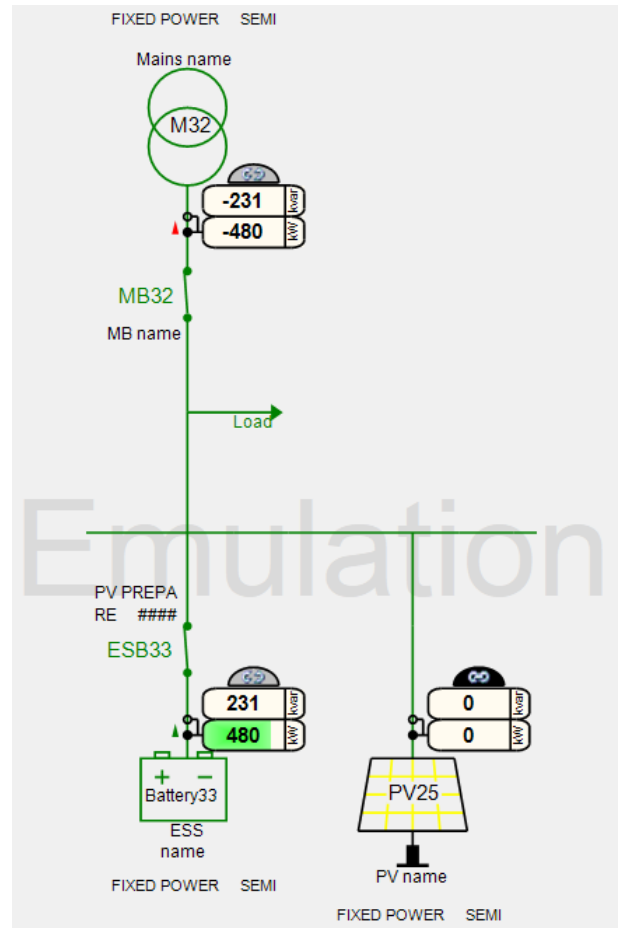

2. Hardware and software

2.1 Overview and options

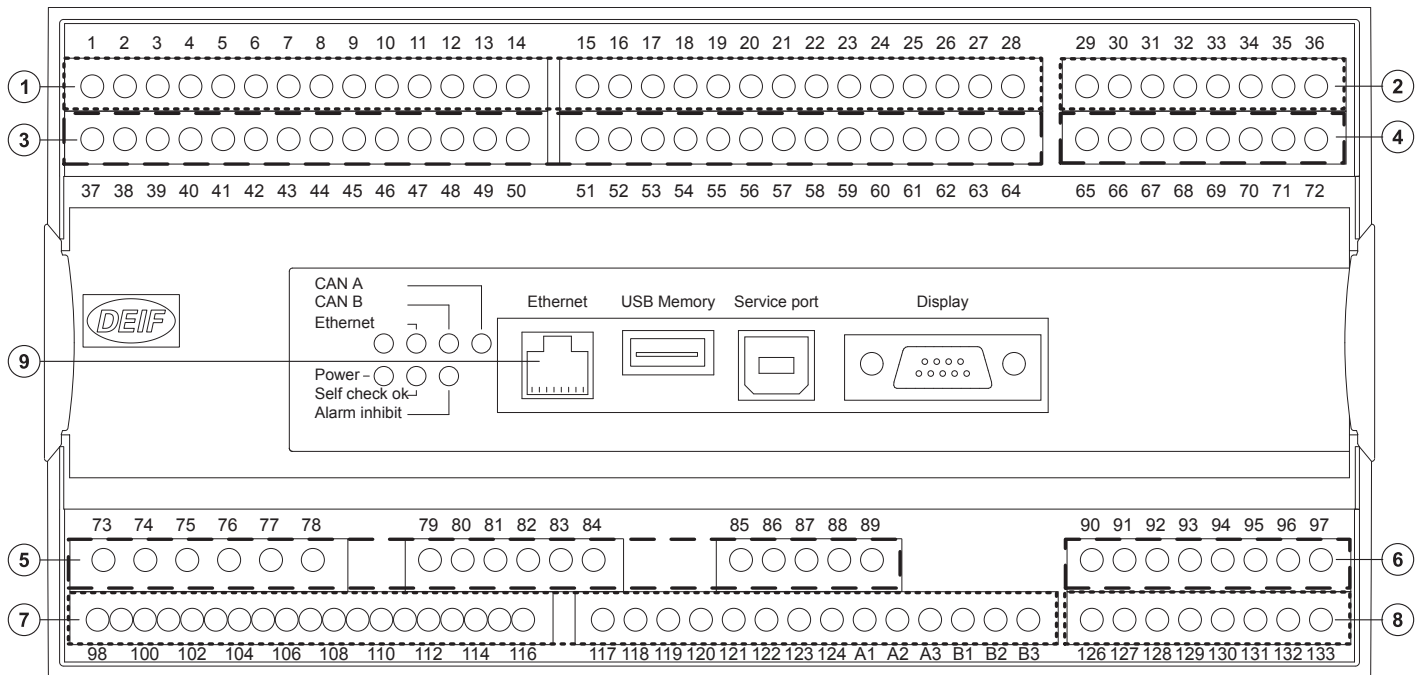

① : The numbers in the drawing above refer to the slot numbers shown in the table below.

Slot #	Option/standard	Description
1		Terminal 1-28, power supply
	Standard	8 to 36 V DC supply, 11 W; 1 × status output relay; 5 × relay outputs; 2 × pulse outputs (kWh, kvarh or configurable open collector outputs); 5 × digital inputs
2		Terminal 29-36, communication
	Standard (H2.2)	Modbus RTU (RS-485)
3		Terminal 37-64, inputs/outputs
	M12	13 × digital inputs; 4 × relay outputs
4		Terminal 65-72, inputs/outputs
	E2	2 × 0(4) to 20 mA outputs, transducer
	M13.4	7 × binary inputs
	M14.4	4 × relay outputs
5		Terminal 73-89, AC measuring
	Standard	3 × ESS current; 3 × ESS voltage + N; 3 × busbar voltage + N
6		Terminal 90-97, inputs/outputs

Slot #	Option/standard	Description
	F1	2 × 0(4) to 20 mA outputs, transducer
	M13.6	7 × digital inputs
	M14.6	4 × relay outputs
	M15.6	4 × 4 to 20 mA inputs
7		Terminal 98-124-A1-A3-B1-B3, communication, inputs/outputs
	M4	8 to 36 V DC supply; 3 × multi-inputs; 7 × digital inputs; 4 × relay outputs Power management communication, CAN port A and B
8		Terminal 126-133, inputs/outputs
	H2.8	Modbus RTU (RS-485). Can work as Modbus client for power meter communication.
	M13.8	7 × digital inputs
	M14.8	4 × relay outputs
	M15.8	4 × 4 to 20 mA inputs
9		LED I/F
	N	Modbus TCP/IP
Accessories		
		AOP-1
		DU-2
Additional hardware options		
	Q1	Class 0.5 calibration
	W1	One-year extended warranty
	W2	Two-year extended warranty
	W3	Three-year extended warranty
Software options		
	G5	Power management
	I1	System emulation
	T1	Critical power (includes redundant controllers)

NOTE There can only be one hardware option in each slot. For example, it is not possible to select option H2.8 and option M13.8 at the same time, because both options require a PCB in slot 8.

3. Compatible products

3.1 Touch display unit: TDU

TDU is a pre-programmed touch screen display (www.deif.com/products/tdu-series). The TDU can be used for these controllers:

- AGC 150 Generator, Mains and BTB
- ASC 150 Solar and Storage
- AGC-4 Mk II Generator, Mains and BTB
- ASC-4 Solar and Battery
- AGC-4 Generator, Mains and BTB

3.2 Power management

You can use these controllers together in a power management system:

- **AGC 150 Generator** (www.deif.com/products/agc-150-generator)
- **AGC 150 Mains** (www.deif.com/products/agc-150-mains)
- **AGC 150 BTB** (www.deif.com/products/agc-150-btb)
- **ASC 150 Solar** (www.deif.com/products/asc-150-solar)
- **ASC 150 Storage** (www.deif.com/products/agc-150-storage)
- **AGC-4 Mk II Genset, Mains, BTB, Group, and Plant** (www.deif.com/products/agc-4-mk-ii)
- **AGC-4 Genset, Mains, BTB, Group, and Plant** (www.deif.com/products/agc-4)
- **ASC-4 Solar** (www.deif.com/products/asc-4-solar)
- **ASC-4 Battery** (www.deif.com/products/asc-4-battery)
- **ALC-4 (Automatic Load Controller)** (www.deif.com/products/alc-4)

3.3 Open PMS

You can use these controllers together in an open power management system:

- **ASC 150 Solar** (www.deif.com/products/asc-150-solar)
- **ASC 150 Storage** (www.deif.com/products/agc-150-storage)
- **AGC 150 Mains** (www.deif.com/products/agc-150-mains)
- **ASC-4 Solar** (www.deif.com/products/asc-4-solar)
- **ASC-4 Battery** (www.deif.com/products/asc-4-battery)
- **AGC-4 Mk II Mains** (www.deif.com/products/agc-4-mk-ii)

You can also use **AGC 150 Generator**, **AGC-4 Mk II Genset** and/or **AGC-4 Genset** as external gensets. That is, the genset controllers are not part of the open PMS. They can send their power measurements to the open PMS controllers over CAN bus.

3.4 Power meters

Power measurements are required in single controller applications, as well as in open PMS applications. The controller can receive measurements from these DEIF power meters:

- **MIB 8000** (www.deif.com/products/mib-8000)
- **MIC-2 MKII** (www.deif.com/products/mic-2-mkii)
- **MTR-4** (www.deif.com/products/mtr-4)



More information

See **Application note, DEIF hybrid controller compatibility** for supported power meters from other suppliers.

3.5 Power measurements from gensets

Power measurements are required in single controller applications, as well as in open PMS applications. The controller can receive measurements from these DEIF genset controllers:

- **AGC 150 Generator** (www.deif.com/products/agc-150-generator)
- **AGC-4 Mk II Genset** (www.deif.com/products/agc-4-mk-ii)
- **AGC-4 Genset** (www.deif.com/products/agc-4)
- **CGC 400** (www.deif.com/products/cgc-400)



More information

See **Application note, DEIF hybrid controller compatibility** for supported power measurements from other genset suppliers.

3.6 Remote monitoring service: Insight

Insight is a responsive remote monitoring service (www.deif.com/products/insight). It includes real-time genset data, a customisable dashboard, GPS tracking, equipment and user management, email and/or SMS alerts, and cloud data management.

3.7 Additional operator panel, AOP-2

The controller uses CAN bus communication to the additional operator panel (AOP-2). Configure the controller using M-Logic. On the AOP-2, the operator can then:

- Use the buttons to send commands to the controller.
- See LEDs light up to show statuses and/or alarms.

3.8 Other equipment

DEIF has a wide variety of other equipment that is compatible. Here are some examples:

- **Synchrosopes**
 - **CSQ-3** (www.deif.com/products/csq-3)
- **Battery chargers/power supplies**
 - **DBC-1** (www.deif.com/products/dbc-1)
- **Current transformers**
 - **ASK** (www.deif.com/products/ask-asr)
 - **KBU** (www.deif.com/products/kbu)
- **Transducers**
 - **MTR-4** (www.deif.com/products/mtr-4)

4. Technical information

4.1 Technical specifications


Accuracy	<p>Class 1.0 -25 to <u>15 to 30</u> to 70 °C Temperature coefficient: ± 0.2 % of full scale per 10 °C Class 0.5 with option Q1 Averaged frequency: ± 10 mHz, 15 to 30 °C, 45 to 65 Hz</p> <p>Positive, negative and zero sequence alarms: Class 1 within 5 % voltage unbalance Class 1.0 for negative sequence current Fast over-current: 3 % of 350 %I_N Analogue outputs: Class 1.0 according to total range Option EF4/EF5: Class 4.0 according to total range To IEC/EN 60688</p>
Operating temperature (including DU-2 display and AOP)	<p>-25 to 70 °C (-13 to 158 °F) -25 to 60 °C (-13 to 140 °F) if Modbus TCP/IP (option N) is available in the controller UL/cUL Listed: Max. surrounding air temperature: 55 °C (131 °F)</p>
Storage temperature (including DU-2 display and AOP)	-40 to 70 °C (-40 to 158 °F)
Climate	97 % RH to IEC 60068-2-30
Operating altitude	<p>0 to 4000 m above sea level Derating 2001 to 4000 m above sea level: Max. 480 V AC phase-phase 3W4 measuring voltage Max. 690 V AC phase-phase 3W3 measuring voltage</p>
Measuring voltage	<p>Nominal value (U_N): 100 to 690 V AC, ± 20 % UL/cUL Listed: 600 V AC phase-phase Consumption: Max. 0.25 VA/phase</p>
Voltage withstand	<p>$U_N + 35$ % continuously $U_N + 45$ % for 10 seconds</p>
Measuring current	<p>Nominal value (I_N): Low: 1 A AC from current transformer High: 5 A AC from current transformer</p> <p>UL/cUL Listed: From listed or R/C (XODW2.8) current transformers 1 or 5 A Consumption: Maximum 0.3 VA/phase</p>
Current overload	<p>$4 \times I_N$ continuously $20 \times I_N$, 10 sec (max. 75 A) $80 \times I_N$, 1 sec (max. 300 A)</p>
Measuring frequency	30 to 70 Hz
Aux. supply	<p>Terminals 1 and 2: 12/24 V DC nominal (8 to 36 V DC operational). Max. 11 W consumption Battery voltage measurement accuracy: ± 0.8 V within 8 to 32 V DC, ± 0.5 V within 8 to 32 V DC @ 20 °C Terminals 98 and 99: 12/24 V DC nominal (8 to 36 V DC operational). Max. 5 W consumption 0 V DC for 10 ms when coming from at least 24 V DC (cranking dropout) The aux. supply inputs are to be protected by a 2 A time-delay fuse. (UL/cUL Listed: AWG 24)</p>

Digital inputs	Optocoupler, bi-directional ON: 8 to 36 V DC Impedance: 4.7 kΩ OFF: <2 V DC
Analogue inputs	-10 to +10 V DC: Not galvanically separated. Impedance: 100 kΩ (M12) 0(4) to 20 mA: Impedance 50 Ω. Not galvanically separated (M15.X)
Multi-inputs	0(4) to 20 mA: 0 to 20 mA, ±1 %. Not galvanically separated Digital: Max. resistance for ON detection: 100 Ω. Not galvanically separated Pt100/1000: -40 to 250 °C, ±1 %. Not galvanically separated. To IEC/EN60751 RMI: 0 to 1700 Ω, ±2 %. Not galvanically separated V DC: 0 to 40 V DC, ±1 %. Not galvanically separated
Relay outputs	Electrical rating: 250 V AC/30 V DC, 5 A. UL/cUL Listed: 250 V AC/24 V DC, 2 A resistive load Thermal rating @ 50 °C: 2 A: Continuously. 4 A: t _{on} = 5 seconds, t _{off} = 15 seconds. (Controller status output: 1 A)
Open collector outputs	Supply: 8 to 36 V DC, max. 10 mA (terminal 20, 21, 22 (com))
Analogue outputs	0(4) to 20 mA and ±25 mA. Galvanically separated. Active output (internal supply). Load maximum 500 Ω. UL/cUL Listed: Max. 20 mA output Update rate: Transducer output: 250 ms. Regulator output: 100 ms Accuracy: Analogue outputs: Class 1.0 according to total range Option EF5: Class 4.0 according to total range To EN/IEC60688
Galvanic separation	Between AC voltage and other I/Os: 3250 V, 50 Hz, 1 min Between AC current and other I/Os: 2200 V, 50 Hz, 1 min Between analogue outputs and other I/Os: 550 V, 50 Hz, 1 min Between digital input groups and other I/Os: 550 V, 50 Hz, 1 min
Response times (delay set to min.)	Mains/Busbar Over-/under-voltage: <50 ms Over-/under-frequency: <50 ms Inverter/Power converter Over-current: <250 ms Over-/under-voltage: <250 ms Over-/under-frequency: <350 ms Overload: <250 ms Other Digital inputs: <250 ms Emergency stop: <200 ms Multi-inputs: 800 ms Wire failure: <600 ms
Mounting	DIN rail mount or base mount with six M4 screws Tightening torque: 1.5 Nm for the six M4 screws (countersunk screws are not to be used)
Safety	To EN 61010-1, installation category (over-voltage category) III, 600 V, pollution degree 2 To UL 508 and CSA 22.2 no. 14-05, over-voltage category III, 600 V, pollution degree 2
EMC/CE	To EN 61000-6-2, EN 61000-6-4, IEC 60255-26

Vibration	3 to 13.2 Hz: 2 mm _{pp} . 13.2 to 100 Hz: 0.7 g. To IEC 60068-2-6 & IACS UR E10 10 to 58.1 Hz: 0.15 mm _{pp} . 58.1 to 150 Hz: 1 g. To IEC 60255-21-1 Response (class 2) 10 to 150 Hz: 2 g. To IEC 60255-21-1 Endurance (class 2) 3 to 8.15 Hz: 15 mmpp. 8.15 - 35 Hz 2g. To IEC 60255-21-3 Seismic (class 2)
Shock (base mount)	10 g, 11 ms, half sine. To IEC 60255-21-2 Response (class 2) 30 g, 11 ms, half sine. To IEC 60255-21-2 Endurance (class 2) 50 g, 11 ms, half sine. To IEC 60068-2-27
Bump	20 g, 16 ms, half sine. To IEC 60255-21-2 (class 2)
Material	All plastic materials are self-extinguishing according to UL94 V1
Plug connections	<p>Controller AC current: 0.75 to 4.0 mm² stranded wire. UL/cUL Listed: AWG 18 AC voltage: 0.5 to 2.5 mm² stranded wire. UL/cUL Listed: AWG 20 Relays: UL/cUL Listed: AWG 22 Terminals 98-116: 0.2 to 1.5 mm² stranded wire. UL/cUL Listed: AWG 24 Other: 0.2 to 2.5 mm² stranded wire. UL/cUL Listed: AWG 24 Tightening torque: 0.5 N·m (5-7 lb-in) Service port: USB B Ethernet/Modbus TCP/IP connector: RJ-45</p> <p>DU-2 display 9-pole D-sub female Tightening torque: 0.2 N·m</p>
Protection	Controller: IP20. DU-2 display and AOP: IP40 (IP54 with gasket: Option L). UL/cUL Listed: Type Complete Device, Open Type. To EN/IEC 60529
Approvals	<p>UL/cUL Listed to UL508 Applies to VDE-AR-N 4105</p> <p>See www.deif.com for the most recent approvals.</p>

UL/cUL Listed	<p>Controller A suitable type 1 (flat surface) enclosure is required: Unventilated/ventilated with filters for controlled/pollution degree 2 environment Flat surface mounting - Type 1 enclosure Installation: To be installed in accordance with the NEC (US) or the CEC (Canada) Use 90 °C copper conductors only Wire Size: AWG 30-12 Tightening torque: 5-7 lb-in. All inputs and outputs (except the AC voltage terminals): These must only be connected to limited voltage circuits from a battery protected by a 2 A DC max. time-delay fuse. Communication circuits: Only connect to communication circuits of a listed system/equipment</p>
	<p>DU-2 Display Flat surface mounting - Type 1 enclosure Power supply: The controller, or a separate Class 2 source</p>
	<p>AOP-2 Wiring: Use 90 °C copper conductors only Mounting: For use on a flat surface of type 1 enclosure. Main disconnect must be provided by installer. Installation: To be installed in accordance with the NEC (US) or the CEC (Canada)</p>
	<p>DC/DC converter for AOP-2 Tightening torque: 0.5 Nm (4.4 lb-in) Wire size: AWG 22-14</p> <p>Tightening torque: Panel door mounting 0.7 N·m, D-sub screw 0.2 N·m</p>
Weight	<p>Controller: 1.6 kg (3.5 lbs.) Option J1/J4/J6/J7: 0.2 kg (0.4 lbs.) Option J2: 0.4 kg (0.9 lbs.) Option J8: 0.3 kg (0.58 lbs.) DU-2 display or AOP: 0.4 kg (0.9 lbs.)</p>

4.2 Unit dimensions in mm (inches)

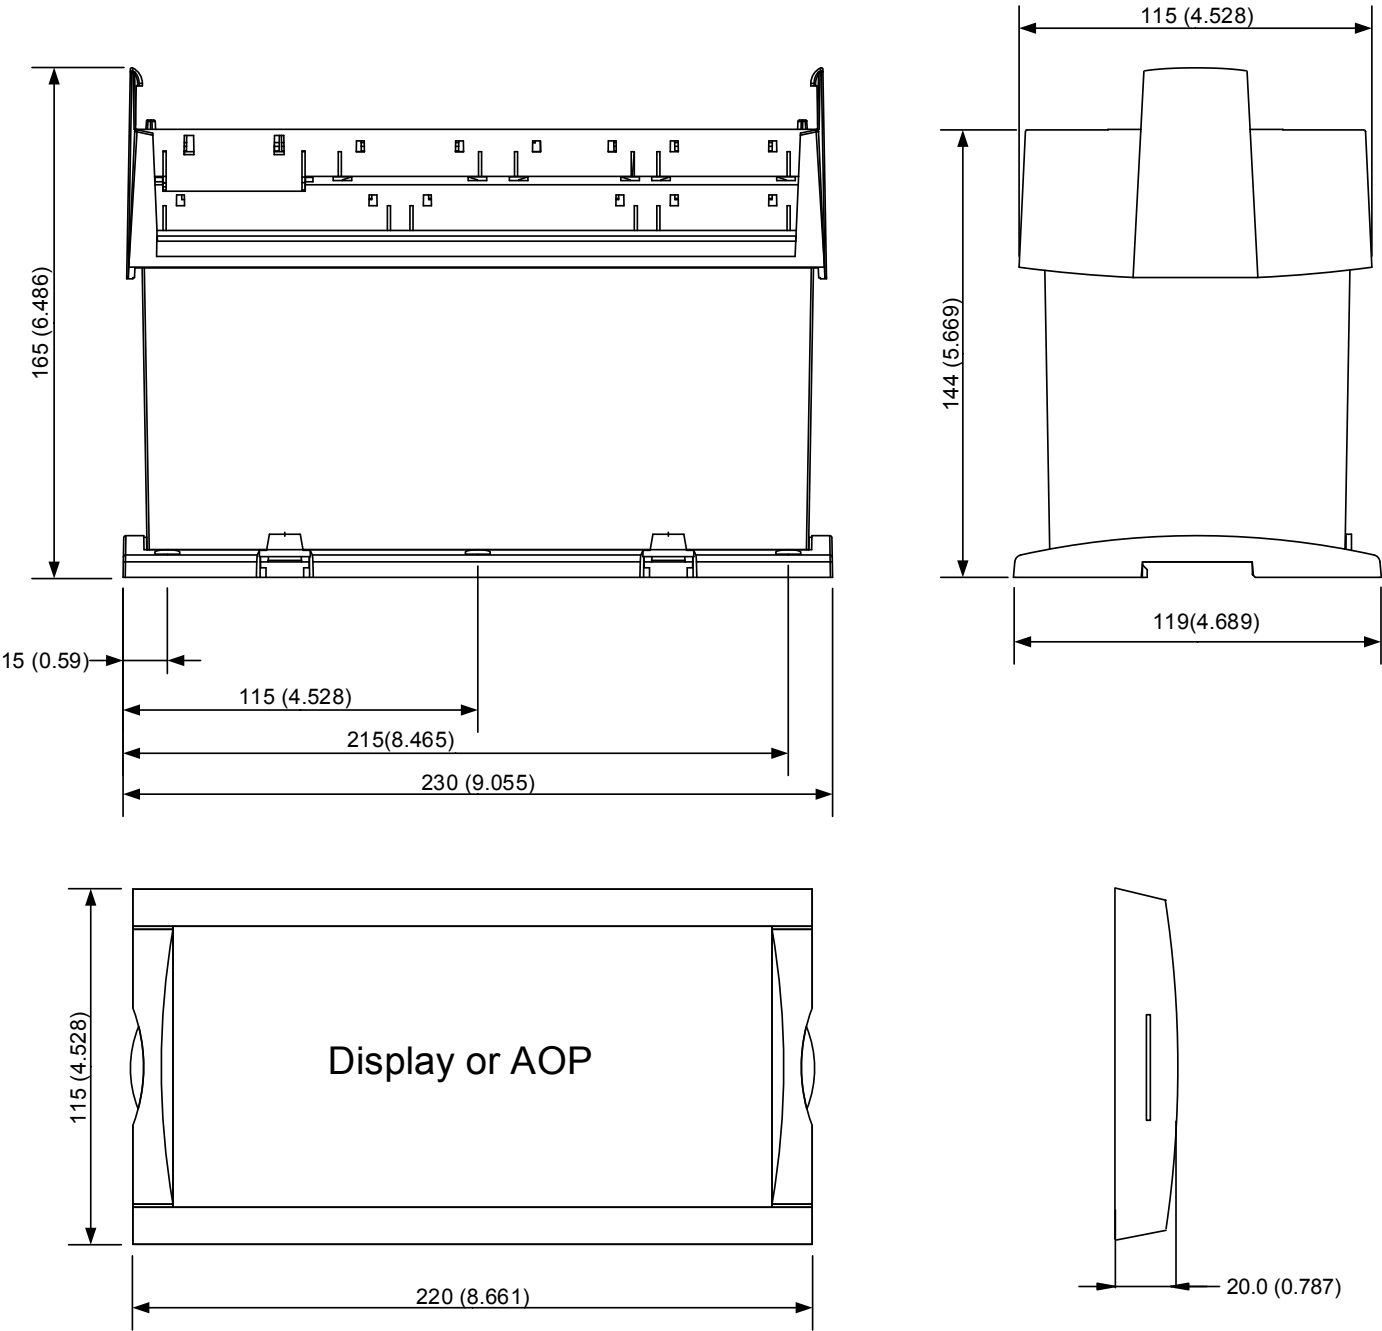

5. Ordering information

5.1 Order specifications

Variants

Type	Options specification				
Type	Option	Option	Option	Option	Option

Example:

Type	Options specification				
Type	Option	Option	Option	Option	Option
ASC-4 Battery	M14.4	M13.6	M15.8		

5.2 Disclaimer

DEIF A/S reserves the right to change any of the contents of this document without prior notice.

The English version of this document always contains the most recent and up-to-date information about the product. DEIF does not take responsibility for the accuracy of translations, and translations might not be updated at the same time as the English document. If there is a discrepancy, the English version prevails.

5.3 Software version

This document is based on ASC-4 software version 4.27.